




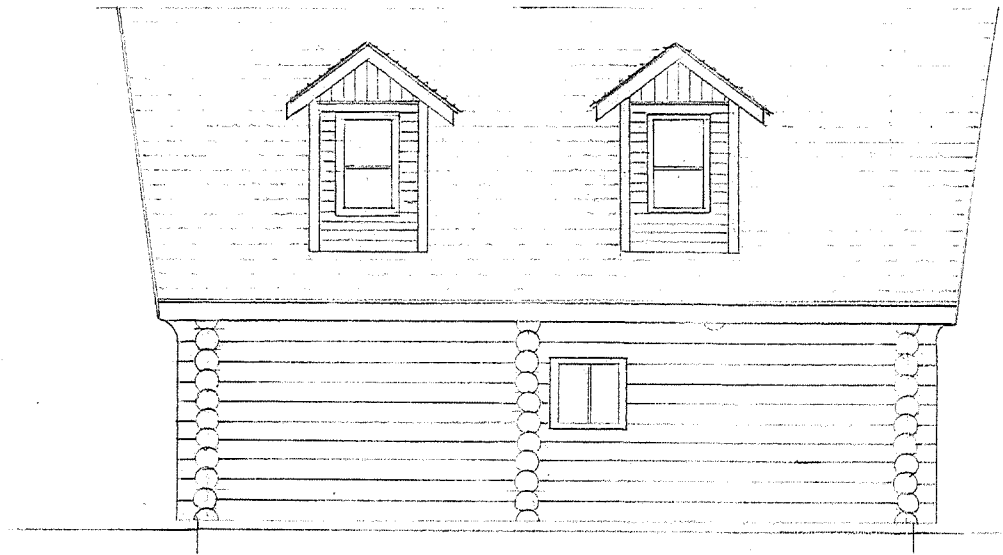


RIGHT ELEVATION  
SCALE:  $\frac{1}{4}" = 1.0'$

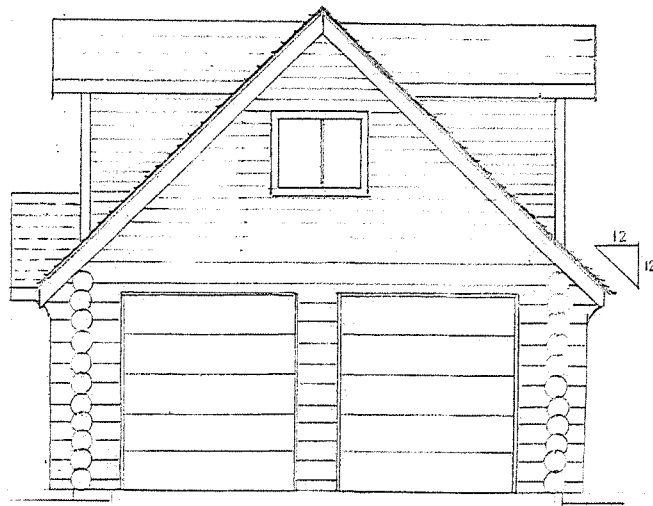

FRONT ELEVATION  
SCALE:  $\frac{1}{4}" = 1.0'$

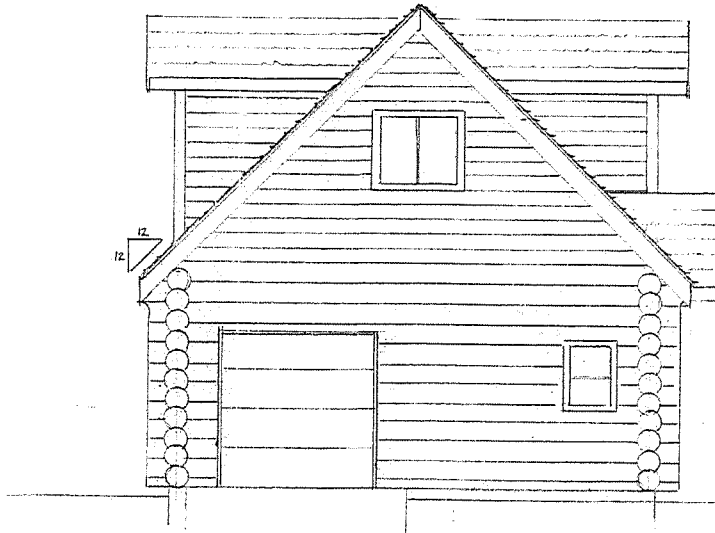


REAR ELEVATION  
SCALE :  $\frac{1}{4}" = 1.0'$

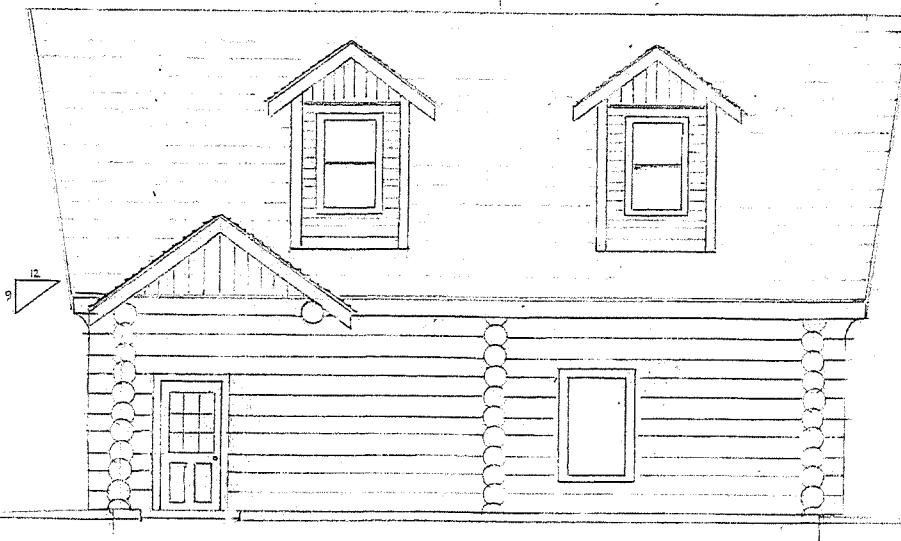

LEFT ELEVATION  
SCALE :  $\frac{1}{4}" = 1.0'$

# FRONT ELEVATION BUILDING SECTION

SCALE: 1/4" = 1'-0"

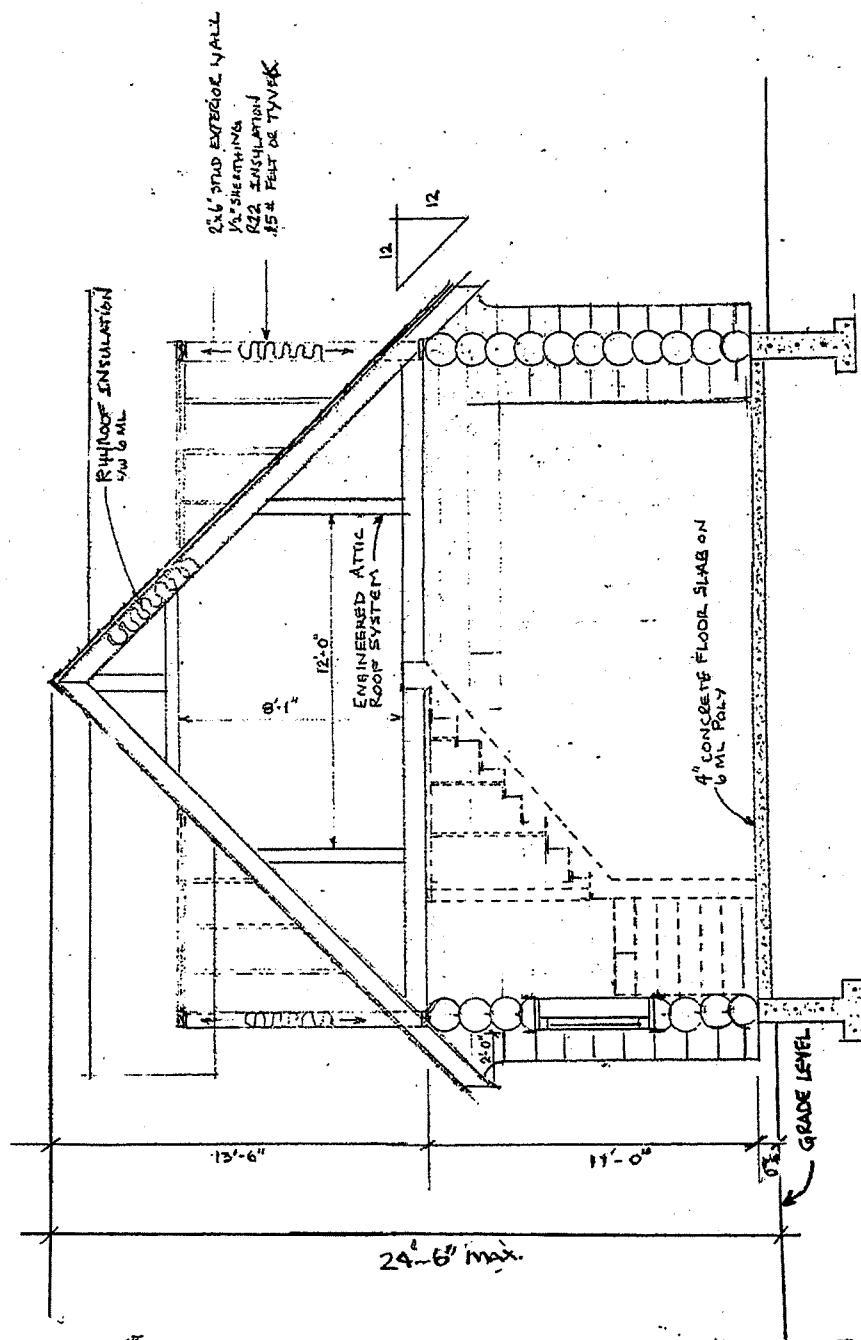

## NOTES:

- 1) ALL EXTERIOR TIMBER SHALL BE: S/P/F NO. 2 OR BETTER FOR LOAD BEARING AND NON-LOAD BEARING MEMBERS INCLUDING JOISTS
- 2) LOFT FLOOR / ATTIC TRUSS SYSTEM DESIGNED AND ENGINEERING FROM SUPPLIER. 5/8" T&S SHEATHING (GLUED)
- 3) ALL LOAD BEARING LINTELS TO BE 2" x 10" - KD FIC
- 4) INTERIOR WALLS 2'x4" S/P/F 16" O.C. ALL WOOD TO CONCRETE ON SILL GASKET
- 5) ALL EXTERIOR WALL ASSEMBLY 2" x 6" 16" O.C. R22 BATT INSULATION 1/2" EXTERIOR SHEATHING 6 MIL POLY 1" x 6" SHIP LAP SIDING
- 6) ROOF ASSEMBLY LAMINATED FIBREGLASS SHINGLES 1/2" SHEATHING 9/16 H CLIPS FELT AS PER MAN. SPECS. COMBINATION 12/12 ENGINEERED ATTIC TRUSS SYSTEM, 9/12 COMMON TRUSSES ON DORMER. INSULATION CEILING R40 MIN.
- 7) STAIRS 42" WIDE 36" HANDRAIL - GRASPABLE 7 1/2" - 8" RISER - 10" RUN + 1" NOSE HEAD ROOM CLEARANCE 6'-0" TO FINISH

LEFT ELEVATION BUILDING SECTION

SCALE:  $\frac{1}{4}" = 1'-0"$

